



100  
0 10  
A1

DO NOT SCALE


File: 0119017-ATK-ZZ-02-DR-CE-090553.dwg  
Date: May 13, 2026 - 7:04pm  
Plotted by: ULH7849

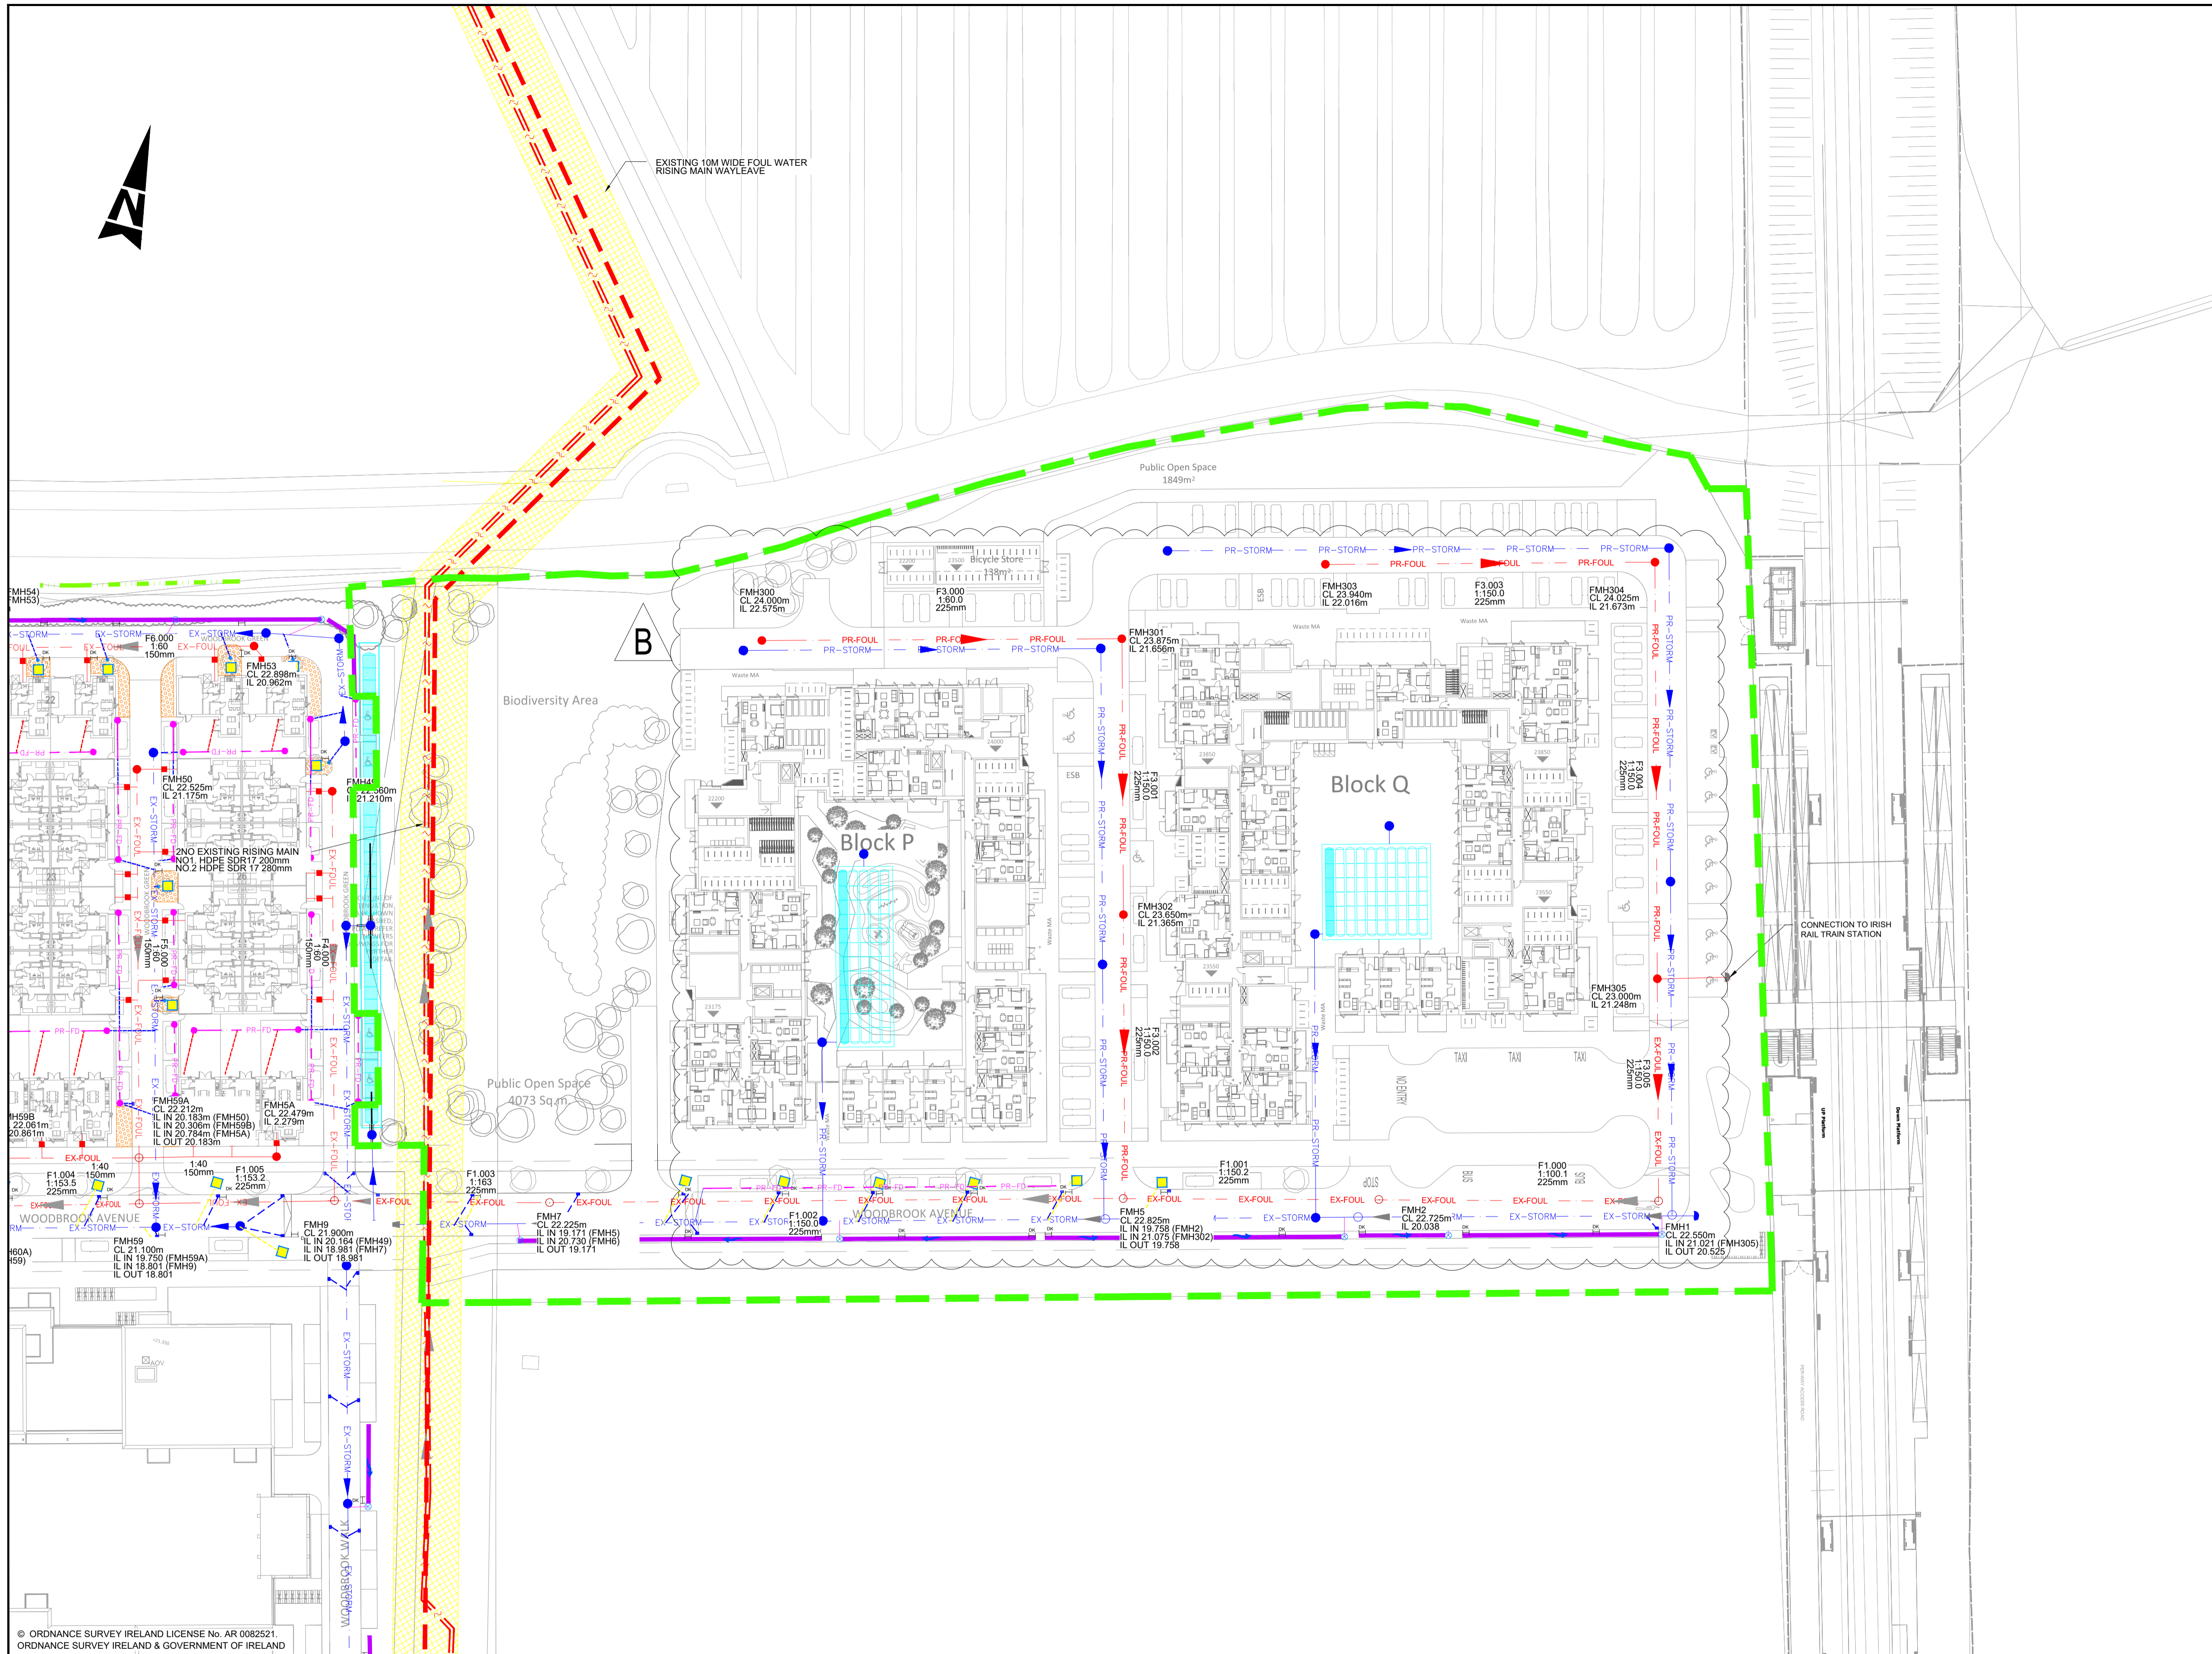

- GENERAL NOTES**
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE
  2. ONLY WRITTEN DIMENSIONS SHALL BE USED. NO DIMENSIONS SHALL BE SCALED FROM THE DRAWINGS
  3. ALL LEVELS ARE IN METRES AND ARE TO MALIN HEAD DATUM
  4. ALL COORDINATES ARE IN METRES AND ARE TO IRISH TRANSVERSE MERCATOR
  5. DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE SPECIFICATION

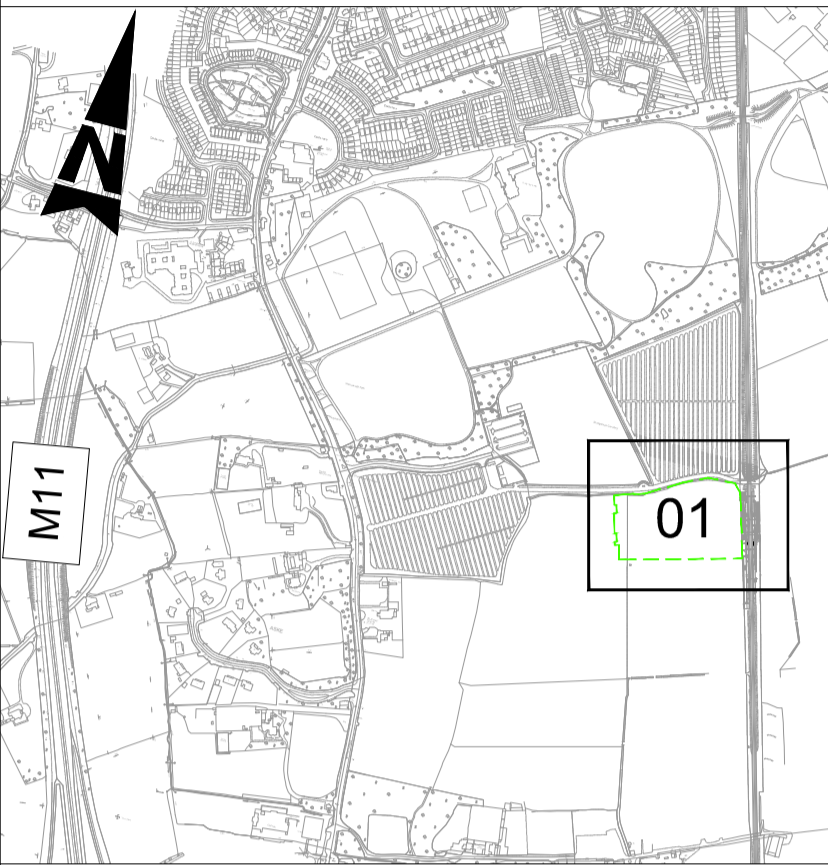

**KEY PLAN**  
Scale NTS

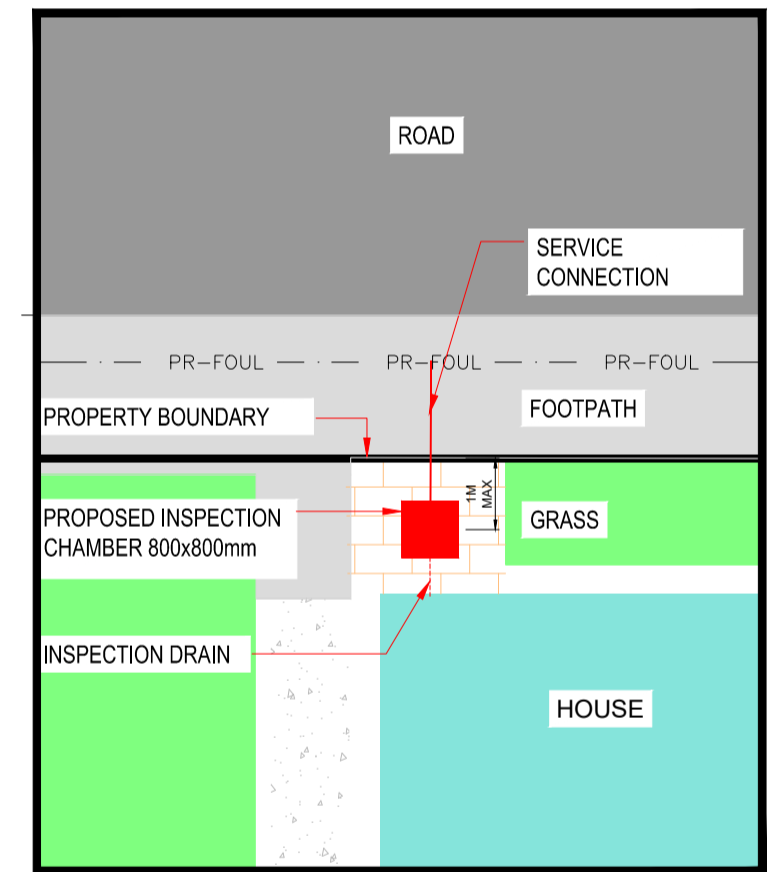

**TYPICAL INSPECTION CHAMBER DETAIL**  
Scale at A1 1:100

**NOTE:**  
INSTALLATION OF FOUL SEWER SHALL BE IN ACCORDANCE WITH IRISH WATER WASTEWATER INFRASTRUCTURE STANDARD DETAILS (IW-CDS-5030-01) & CODE OF PRACTICE FOR WASTEWATER INFRASTRUCTURE (IW-CDS-5030-03) INSTALLATION OF FOUL SEWER AND ALL OTHER DEVELOPMENT SERVICES SHALL BE IN ACCORDANCE WITH IRISH WATER STD-WW-05

**PLANNING NOTES:**  
PLANNING DRAWINGS HAVE BEEN SENT TO UISCE ÉIREANN FOR STATEMENT OF DESIGN ACCEPTANCE. AWAITING RESPONSE FROM UISCE ÉIREANN.

Purpose: **FOR PLANNING**

**LEGEND**

	PROPOSED (UPVC) GRAVITY FOUL DRAINAGE, DIAMETER AS INDICATED (IW-CDS-5030-03, SECTION 3.13.3)		EXISTING FOUL RISING MAIN 630mm OD & WAYLEAVE
	EXISTING (UPVC) GRAVITY FOUL DRAINAGE, PREVIOUSLY GRANTED PERMISSION, ABP SHD PLANNING REFERENCE ABP-305844-19		EXISTING FOUL MANHOLE (IW-STD-WW-09.10.11.12)
	PROPOSED FOUL MANHOLE (IW-STD-WW-09.10.11.12)		PROPOSED STORM PIPE
	EXISTING RISING MAIN, 200mm OD HDPE SDR17		PROPOSED STORM WATER MANHOLE
	PROPOSED INSPECTION CHAMBER & 100MM PVC CONNECTION (IW-STD-WW-03, 13)		AREA SUBJECT TO PROPOSED DEVELOPMENT

	PROPOSED (UPVC) GRAVITY FOUL DRAINAGE, DIAMETER AS INDICATED (IW-CDS-5030-03, SECTION 3.13.3)		EXISTING FOUL RISING MAIN 630mm OD & WAYLEAVE
	EXISTING (UPVC) GRAVITY FOUL DRAINAGE, PREVIOUSLY GRANTED PERMISSION, ABP SHD PLANNING REFERENCE ABP-305844-19		EXISTING FOUL MANHOLE (IW-STD-WW-09.10.11.12)
	PROPOSED FOUL MANHOLE (IW-STD-WW-09.10.11.12)		PROPOSED STORM PIPE
	EXISTING RISING MAIN, 200mm OD HDPE SDR17		PROPOSED STORM WATER MANHOLE
	PROPOSED INSPECTION CHAMBER & 100MM PVC CONNECTION (IW-STD-WW-03, 13)		AREA SUBJECT TO PROPOSED DEVELOPMENT

Rev	Description	By	Date	Chk'd	Auth
B	FOR PLANNING	IH	13.05.26	SK	GH
A	FOR PLANNING	IH	09.12.25	SK	GH
-	FOR INFORMATION	IH	12.05.25	SK	GH

**AtkinsRéalis**

Atkins House, 150-155 Airside  
Business Park, Swords, Co. Dublin  
Tel (+353) 01 810 8000  
Fax (+353) 01 810 8001

Unit 2B, 2200 Cork Airport  
Business Park, Cork  
Tel (+353) 021 429 0300  
Fax (+353) 021 429 0360

2nd Floor Technology House  
Parkmore Technology Park, Galway  
Tel (+353) 091 786 050  
Fax (+353) 091 779 830

Client	AEVAL UNLIMITED COMPANY
Project	WOODBROOK DART GATEWAY

Title: <b>PROPOSED FOUL DRAINAGE LAYOUT</b>			
Original Scale	Design/Drawn	Checked	Authorised
1:500@A1	IH	SK	GH
1:1000@A3	Date 12.05.25	Date 12.05.25	Date 12.05.25
Status	Drawing Number	Rev	
P	0119017-ATK-ZZ-XX-DR-CE-090553	B	